

SECTION 4

ELECTRIC MOTORS

UNIT 17: TYPES OF ELECTRIC MOTORS

UNIT OBJECTIVES

After studying this unit, the reader should be able to

- Describe the different types of open single-phase motors used to drive fans, compressors, and pumps.
- Describe the applications of the various types of motors.
- State which motors have high starting torque.
- List the components that cause a motor to have a higher starting torque.
- Describe a multispeed permanent split-capacitor motor and indicate how the different speeds are obtained.

UNIT OBJECTIVES

After studying this unit, the reader should be able to

- Explain the operation of a three-phase motor.
- Describe a motor used for a hermetic compressor.
- Explain the motor terminal connections in various compressors.
- Describe the different types of compressors that use hermetic motors.
- Describe the use of variable-speed motors.



USES OF ELECTRIC MOTORS

- Used to turn fans, pumps and compressors
- Facilitate the circulation of air, water, refrigerant and other fluids
- Motors are designed for particular applications
- The correct motor must always be used
- Most motors operate on similar principles

Refrigeration & Air Conditioning Technology

SIXTH EDITION

Fans are used to move air

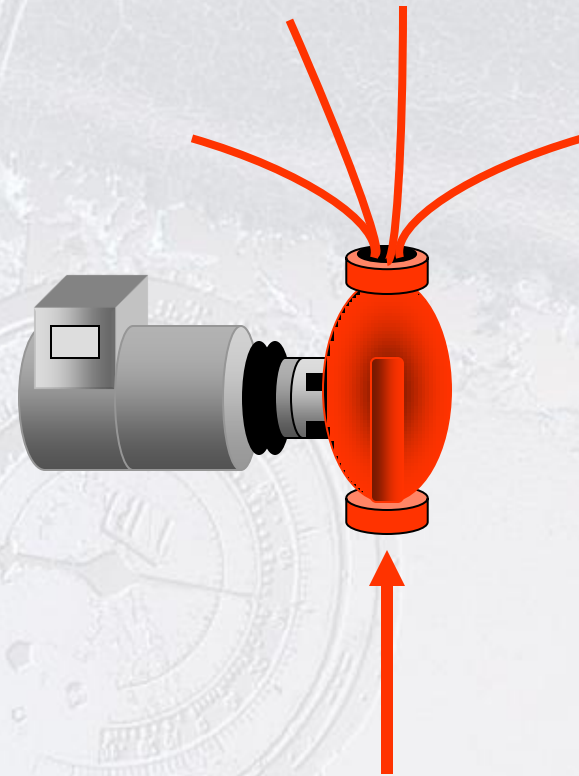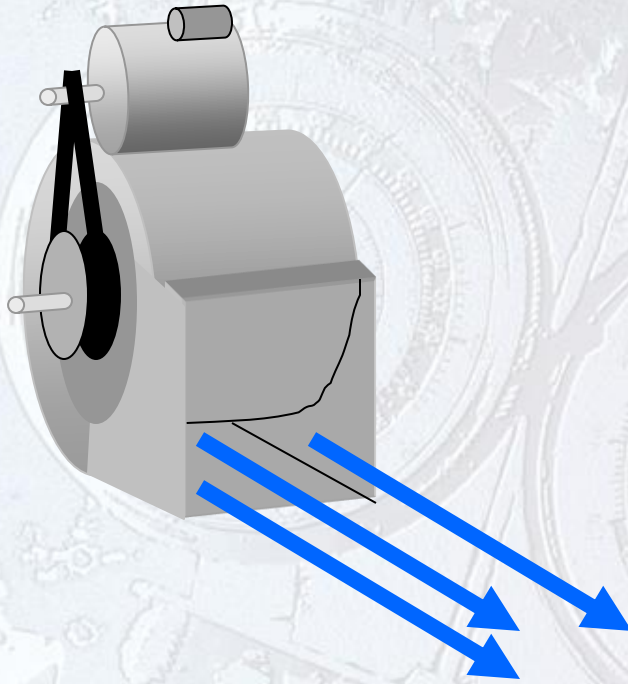


Pumps are used to move liquids

PARTS OF AN ELECTRIC MOTOR

- Stator with motor windings – Stationary portion of the motor
- Rotor – Rotating portion of the motor
- Bearings – Allow free rotation of the motor shaft
- End bells – Supports the bearings and/or shaft
- Housing – Holds all motor components together and facilitates motor mounting

Refrigeration & Air Conditioning Technology

SIXTH EDITION

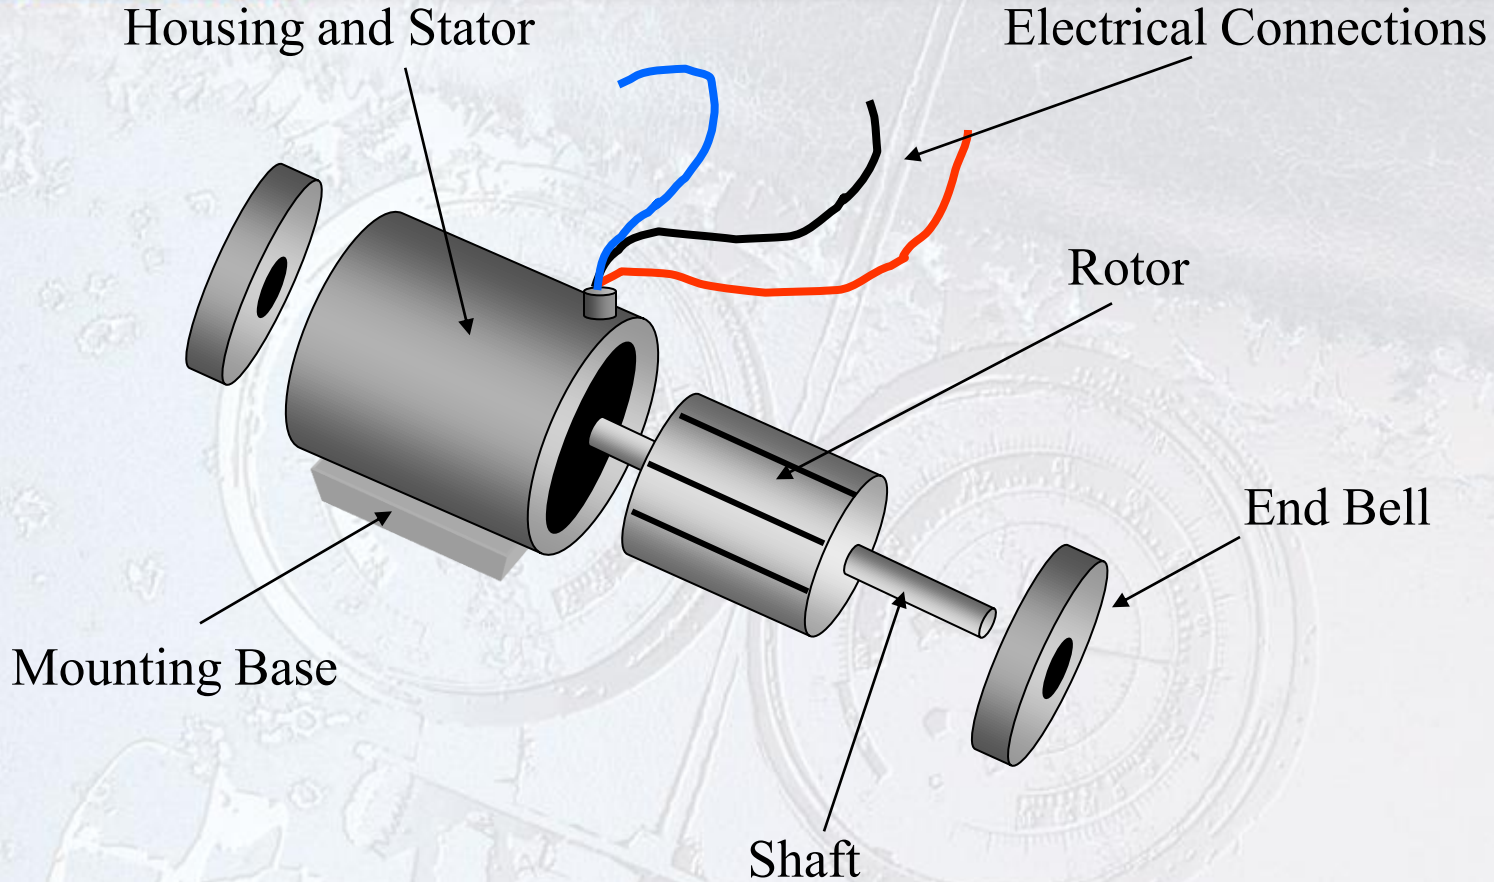

Parts of an electric motor


ELECTRIC MOTORS AND MAGNETISM

- Electricity and magnetism are used to create rotation
- Stator has insulated windings called run windings
- Rotor may be constructed of bars
 - Squirrel cage rotor
 - Positioned between the run windings
- Rotor turns within the magnetic field

Refrigeration & Air Conditioning Technology

SIXTH EDITION

Magnet supported from above

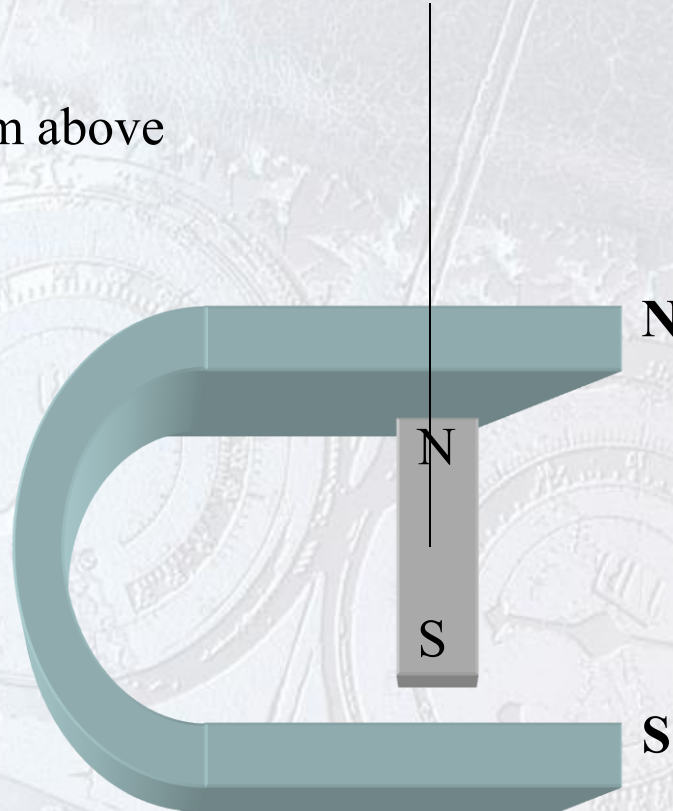

Since unlike poles repel each other, the magnet will rotate

Stationary Magnet

Refrigeration & Air Conditioning Technology

SIXTH EDITION



Stationary Magnet

Refrigeration & Air Conditioning Technology

SIXTH EDITION



Stationary Magnet

Refrigeration & Air Conditioning Technology

SIXTH EDITION



Stationary Magnet

Refrigeration & Air Conditioning Technology

SIXTH EDITION



Stationary Magnet

Refrigeration & Air Conditioning Technology

SIXTH EDITION



Stationary Magnet

Refrigeration & Air Conditioning Technology

SIXTH EDITION



When the unlike poles are lined up with each other, rotation will stop

Stationary Magnet

DETERMINING MOTOR SPEED

- As the number of poles increases, the motor speed decreases
- Motor Speed (rpm) = Frequency x 120 ÷ # of poles
- In the United States the frequency is 60 Hz
- For example, a 2 pole motor will turn at a speed of $60 \times 120 \div 2 = 7200 \div 2 = 3600$ rpm
- The motor will turn at a speed that is lower than the calculated value
- Slip = difference between calculated and actual motor speed

THE START WINDING

- Enables the motor to start and in the right direction
- Start winding has higher resistance than the run winding
- Wound with more turns than the run winding
- Wound with smaller diameter wire than the run winding
- Removed from the active circuit once the motor starts

STARTING AND RUNNING CHARACTERISTICS

- Refrigeration compressors have high starting torque
- Starting torque – twisting force that starts the motor
- Locked Rotor Amperage (LRA)
- Full Load Amperage (FLA)
- Rated Load Amperage (RLA)
- Motor may start with unequal pressures across it
- Small fans do not require much starting torque

ELECTRICAL POWER SUPPLIES


- Residences are furnished with single-phase power
- Houses can be supplied power from the transformer
- Power feeds into circuit breaker panel or fuse box
- Circuit breakers protect each individual circuit
- Power is distributed throughout the house
- Typical residential panels provide 115 and 230 volts
- Commercial and industrial facilities require three-phase power

Refrigeration & Air Conditioning Technology

SIXTH EDITION

Individual 115-volt circuits with 115-volt, single-phase circuit breakers

230-volt two-pole circuit breakers and 230-volt circuits

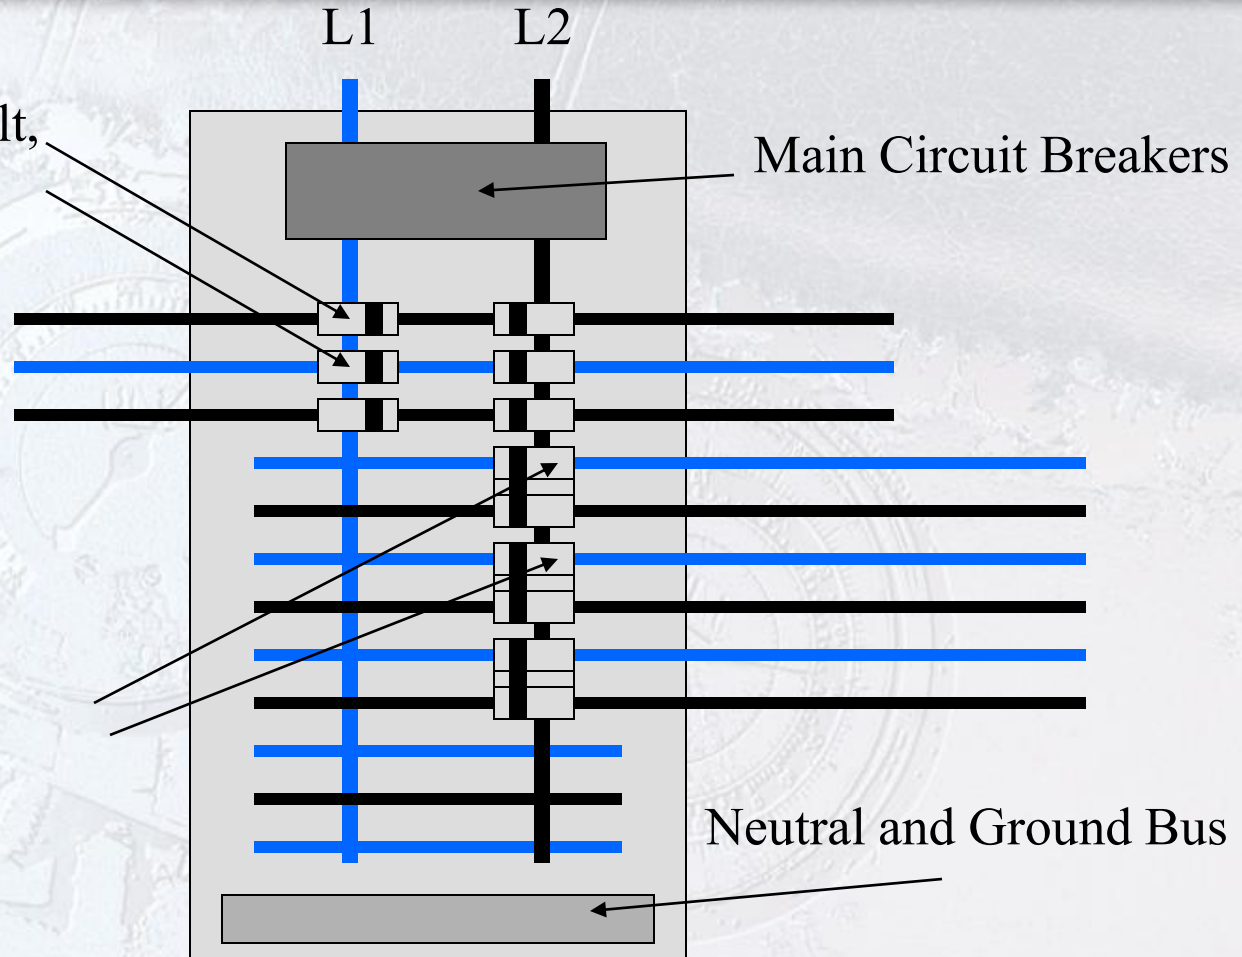

RESIDENTIAL CIRCUIT BREAKER PANEL


SINGLE-PHASE OPEN MOTORS

- Residential motors operate at 115, 208 or 230V
- Commercial motors operate at voltages up to 460V
- Some motors are designed to operate at one of two different voltage (dual voltage motors)
- Dual voltage motors are wired differently for each voltage
- Some motors have reversible rotations

Refrigeration & Air Conditioning Technology

SIXTH EDITION

DUAL VOLTAGE MOTOR (230-VOLTS)

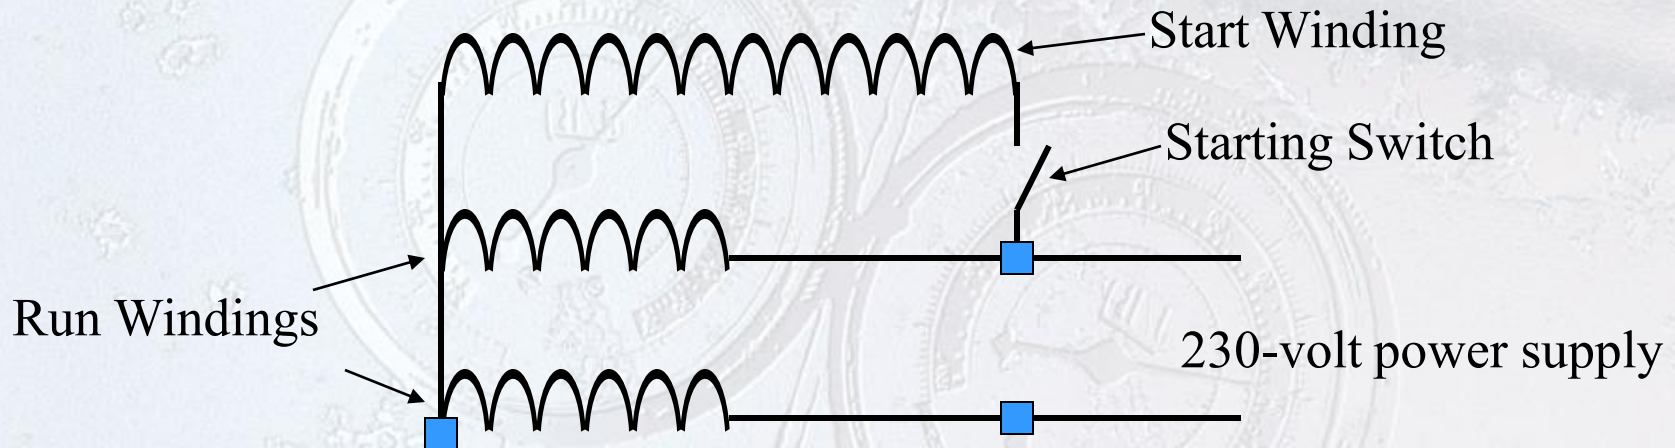


Run windings are wired in series with each other for high- voltage application

Refrigeration & Air Conditioning Technology

SIXTH EDITION

DUAL VOLTAGE MOTOR (115-VOLTS)

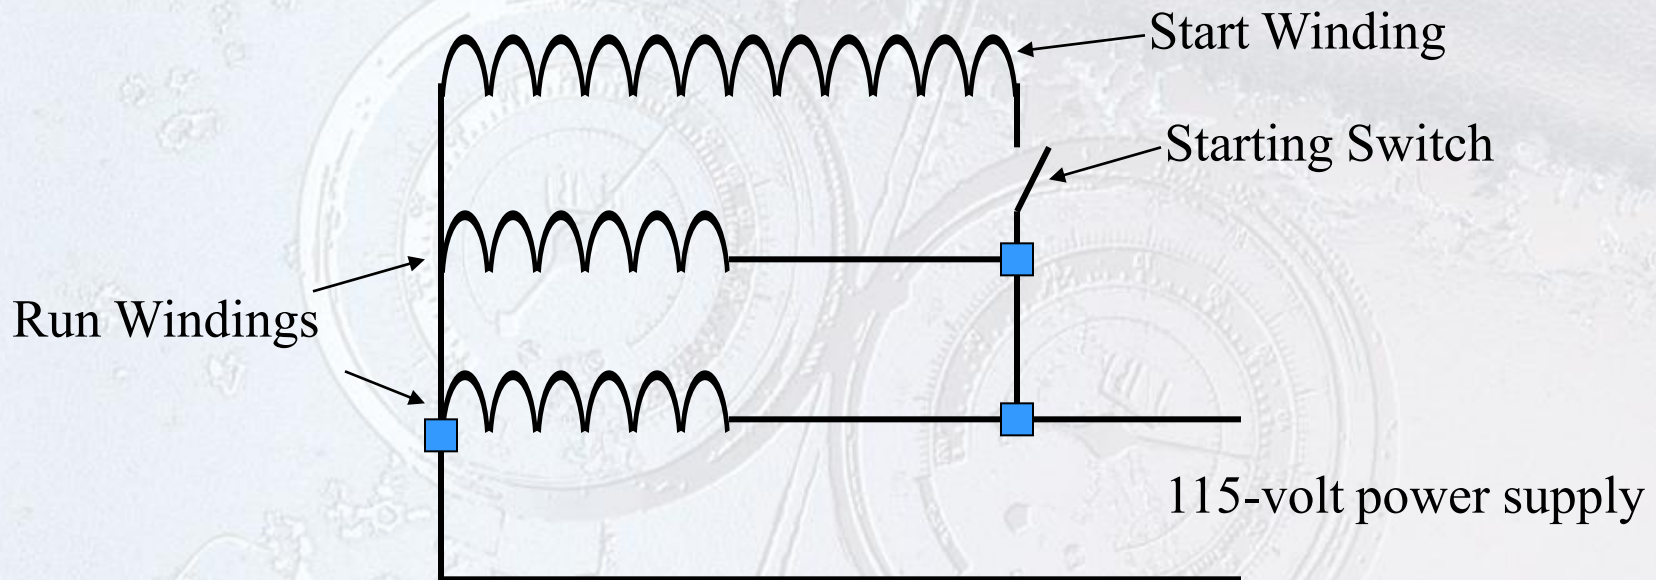

Run windings are wired in parallel with each other for low-voltage applications

SPLIT-PHASE MOTORS

- Two separate motor windings
- Good running efficiency
- Medium amount of starting torque
- Speed typically ranges from 1800 – 3600 rpm
- Motor speed is determined by the number of poles
- Slip is the difference between the calculated and actual motor speeds

Refrigeration & Air Conditioning Technology

SIXTH EDITION

START WINDING

Small Wire

Large Number of Turns

High Resistance

L1


RUN WINDING

Larger Wire

Small Number of Turns


Low Resistance

L2

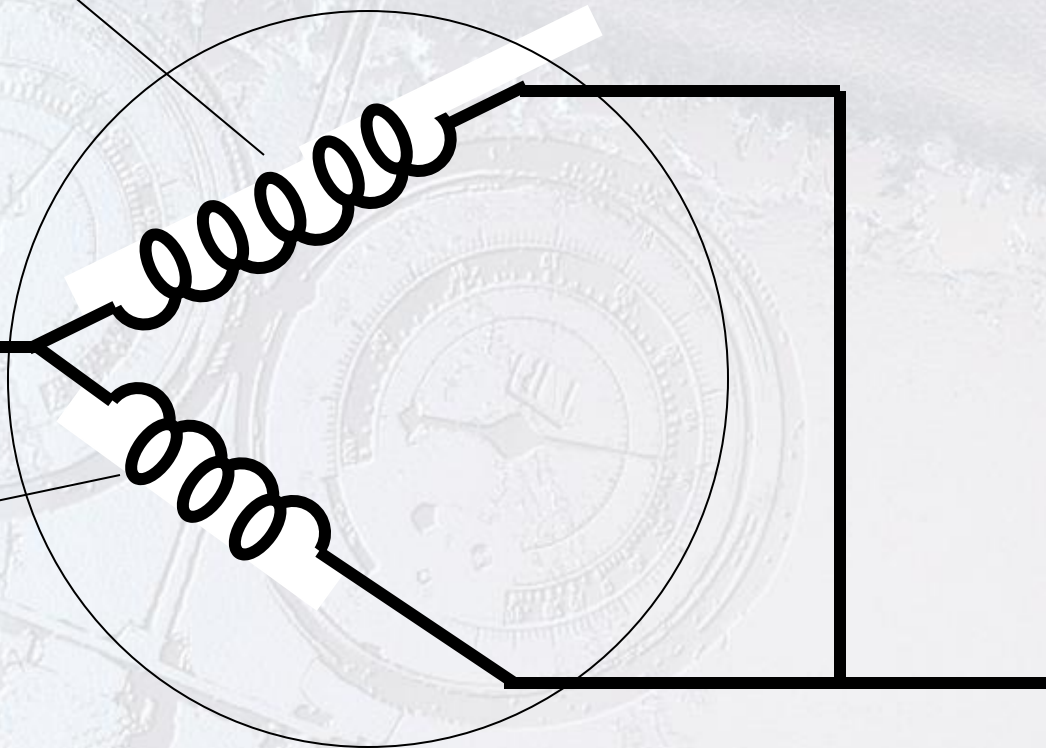

Refrigeration & Air Conditioning Technology

SIXTH EDITION

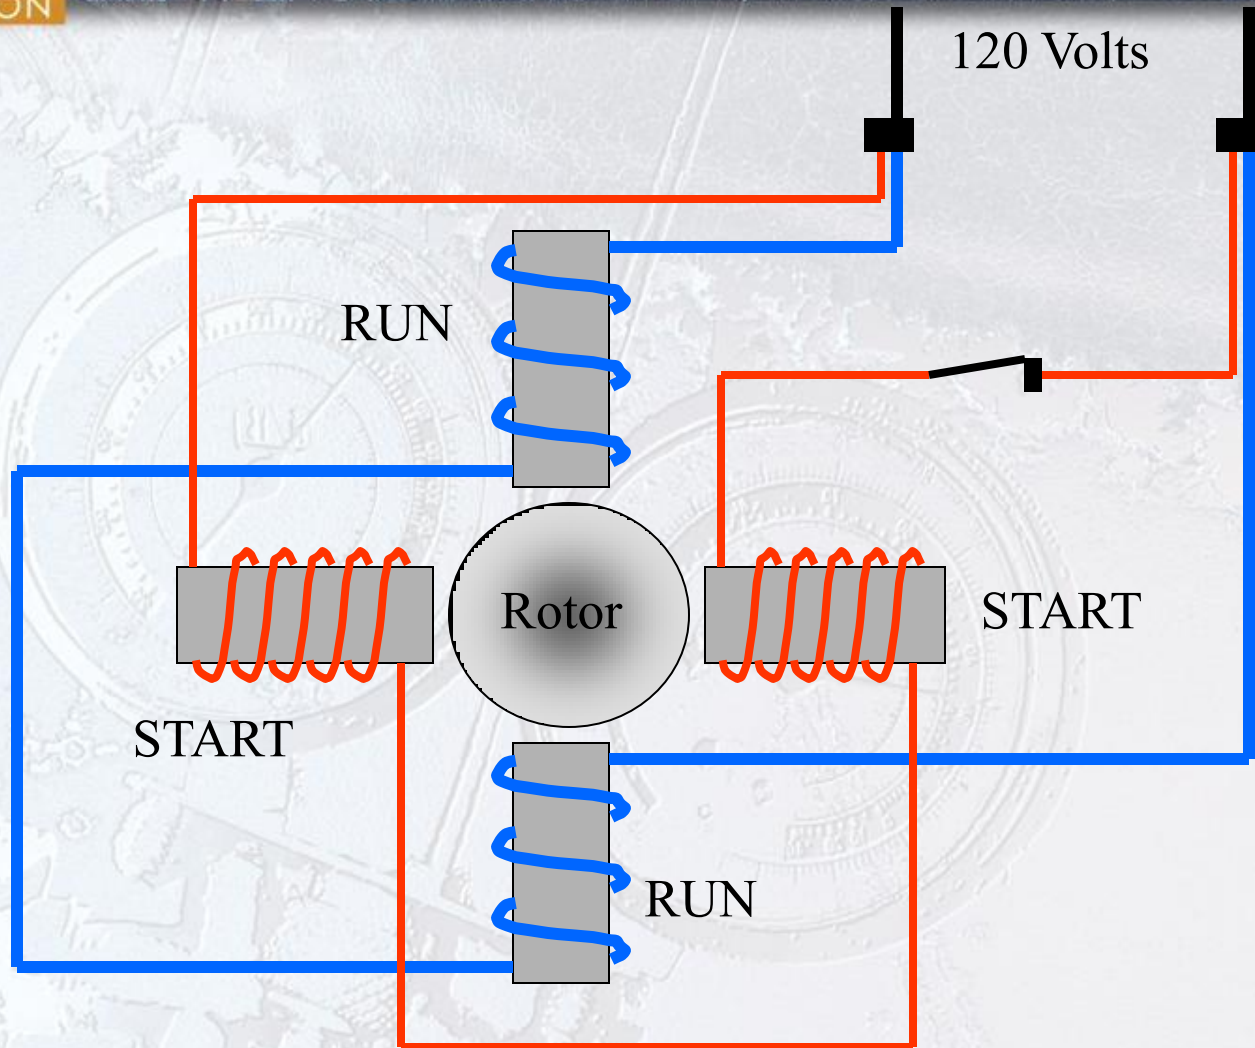

THE CENTRIFUGAL SWITCH

- Commonly used on open motors to de-energize the start winding
- Opens its contacts when the motor reaches about 75% of its rated speed
- When the contacts open and close, a spark is created (arcing)
- Not used in a refrigerant atmosphere

Refrigeration & Air Conditioning Technology

SIXTH EDITION

START WINDING

Small Wire

Large Number of Turns

High Resistance

L1

RUN WINDING

Larger Wire

Small Number of Turns

Low Resistance


THE CENTRIFUGAL SWITCH



CAPACITOR-START MOTOR

- Split phase motor with start and run windings
- Start capacitor assists the motor starting by increasing the starting torque
- Start capacitor is wired in series with the motor's start winding
- Start capacitor is removed from the circuit when the start winding is removed
- Start capacitor increases the phase angle

CAPACITOR-START MOTOR

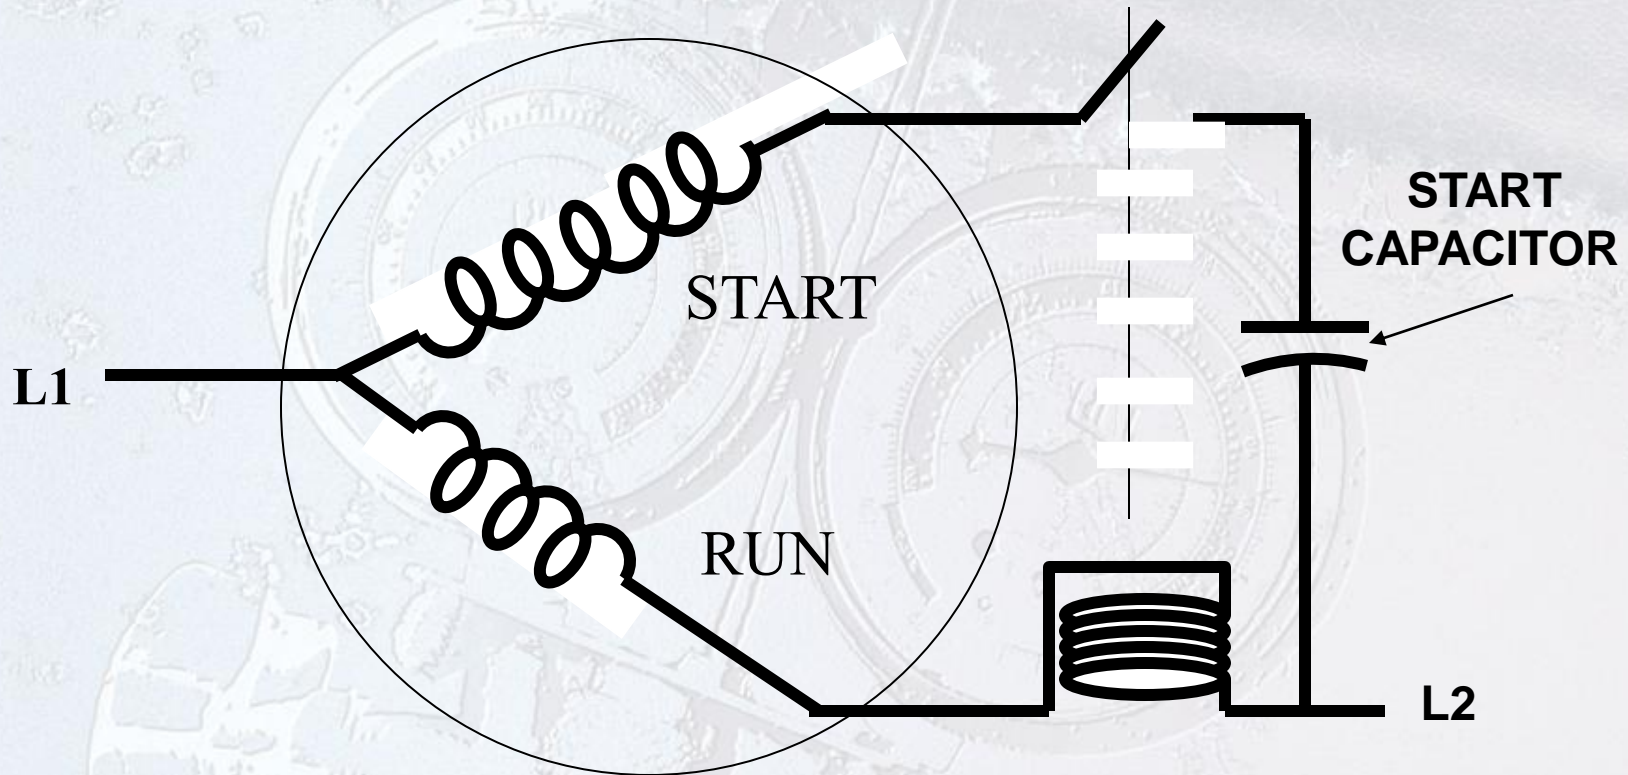

PHASE ANGLE

- Number of electrical degrees between the current and the voltage
- In a resistive circuit the current and voltage are in phase with each other and the phase angle is zero
- The current can lead or lag the voltage
- In inductive circuits, the current lags the voltage
- In capacitive circuits, the current leads the voltage


CAPACITOR-START, CAPACITOR-RUN MOTOR

- Most efficient single-phase motor
- Often used with belt-driven fans and blowers
- Run capacitor improves running efficiency
- Run capacitor is in the circuit whenever the motor is energized
- Start and run capacitors are wired in parallel
- Motor amperage will rise if run capacitor goes bad

Refrigeration & Air Conditioning Technology

SIXTH EDITION

CAPACITOR-START, CAPACITOR-RUN MOTOR (CSCR)

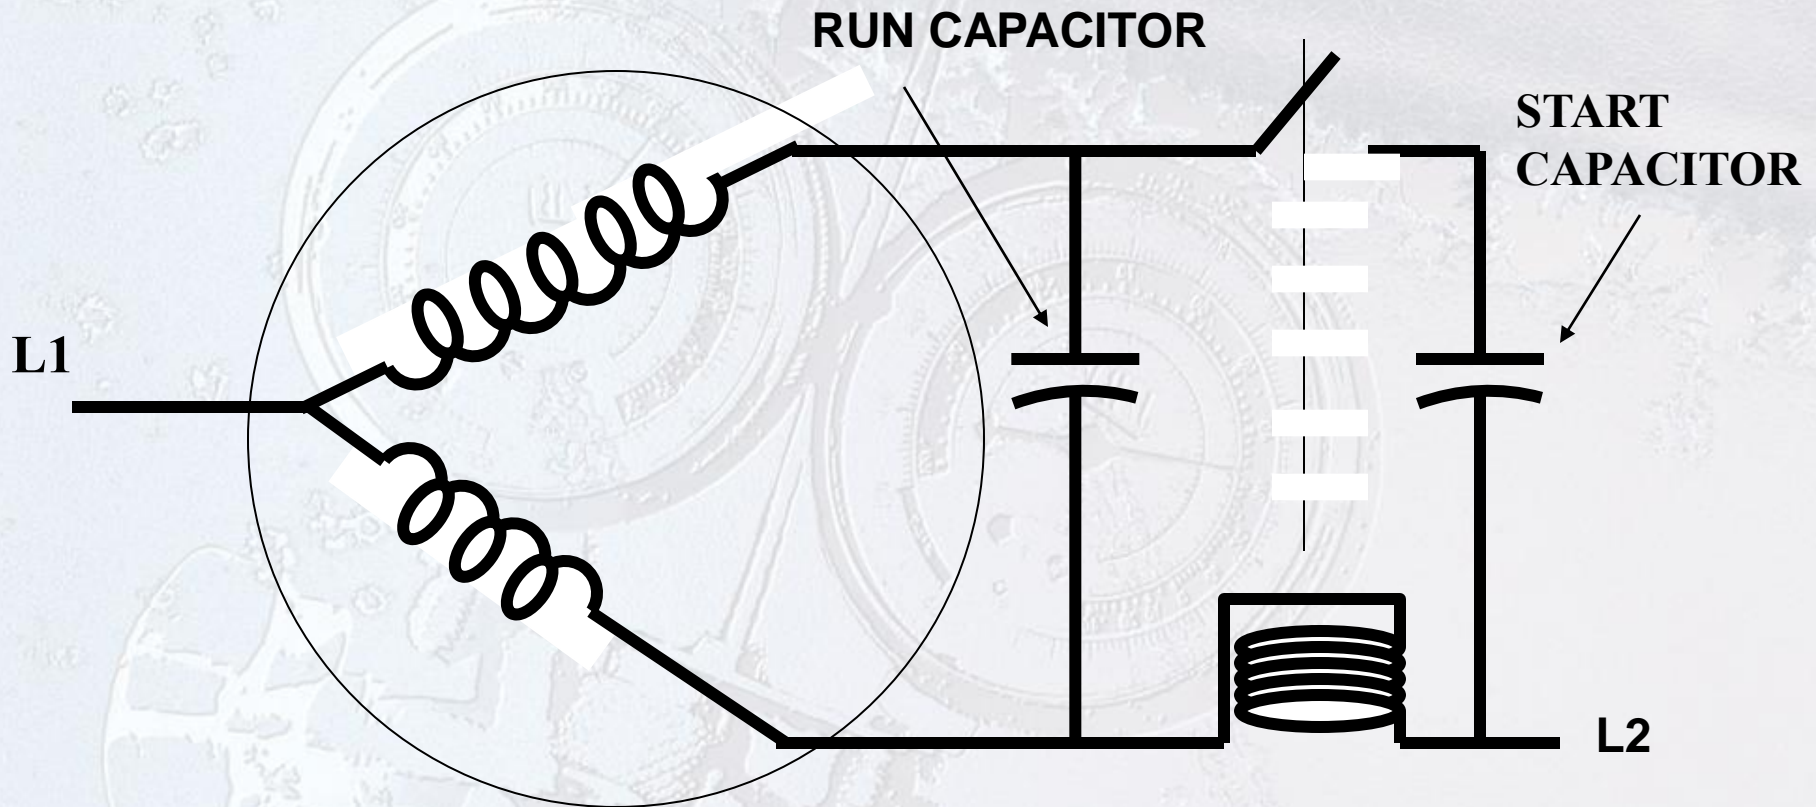


PERMANENT SPLIT CAPACITOR (PSC) MOTOR

- Simplest split-phase motor
- Only a run capacitor is used
- Low starting torque and good running efficiency
- Can be single or multispeed motors
- Multispeed motors have leads for each speed
- As the resistance decreases, motor speed increases
- As the resistance increases, motor speed decreases

Refrigeration & Air Conditioning Technology

SIXTH EDITION


PERMANENT SPLIT CAPACITOR MOTOR (PSC)

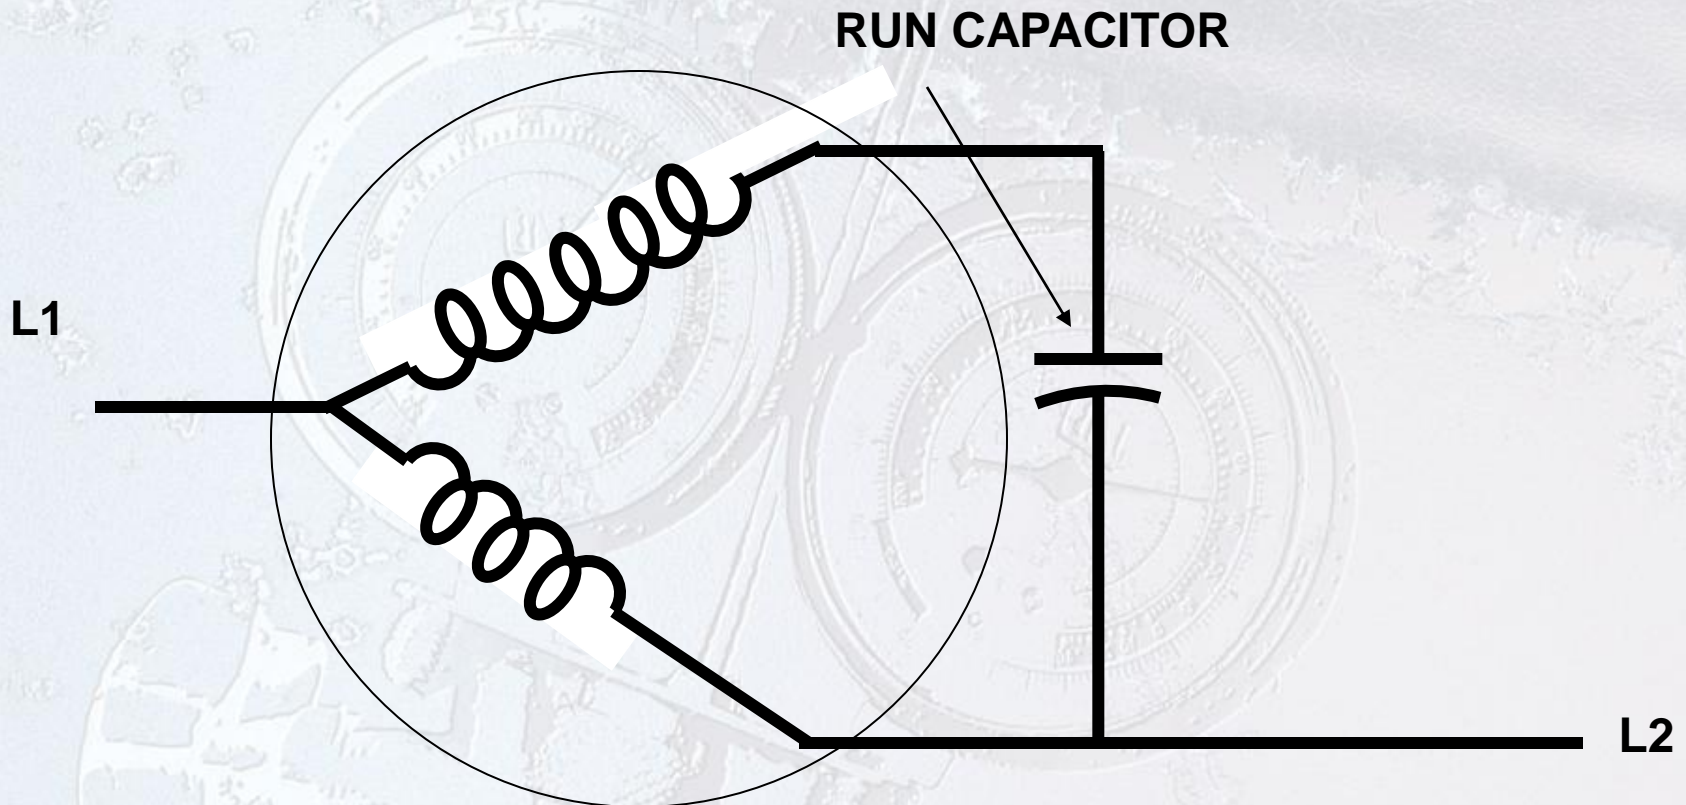

SHADED-POLE MOTOR

- Very low starting torque
- Not as efficient as the PSC motor
- A portion of the run winding is shaded to provide the imbalance in magnetic field that allows the motor to start
- Heavy copper wire or bands are used to shade the run winding
- Manufactured in the fractional horsepower range

THE SHADED POLE MOTOR

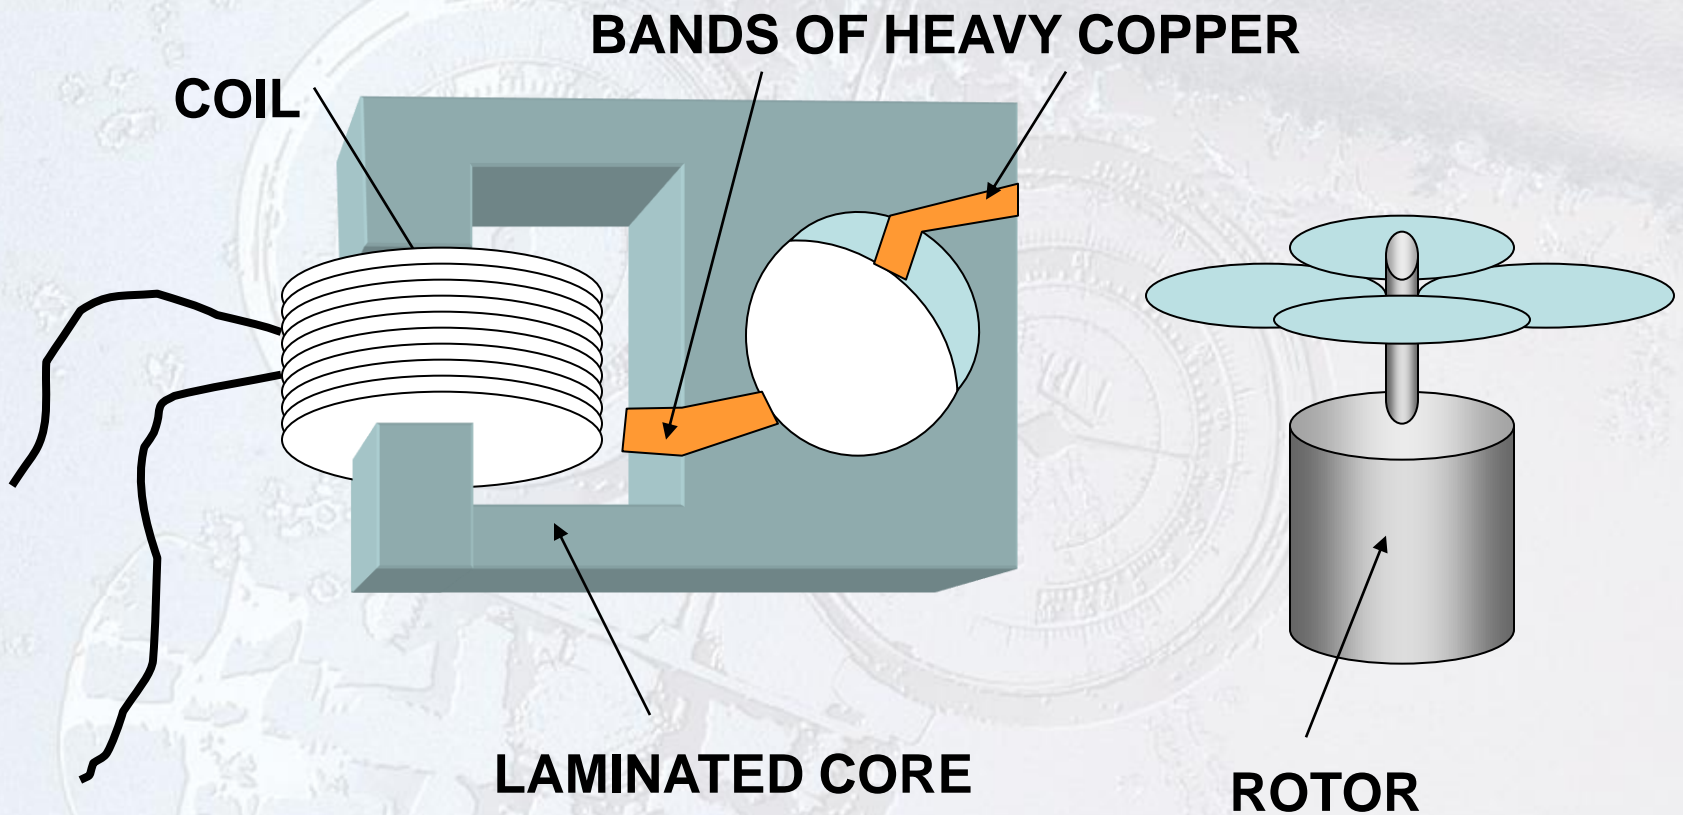


THREE-PHASE MOTOR

- Normally used on commercial applications
- Must have a three-phase power supply
- Powered by three single-phase power supply legs
- Has no start winding or capacitors
- Very high starting torque
- Rotation of motor can be changes by switching any two power legs

Refrigeration & Air Conditioning Technology

SIXTH EDITION

THREE-PHASE 220-VOLT POWER SUPPLY

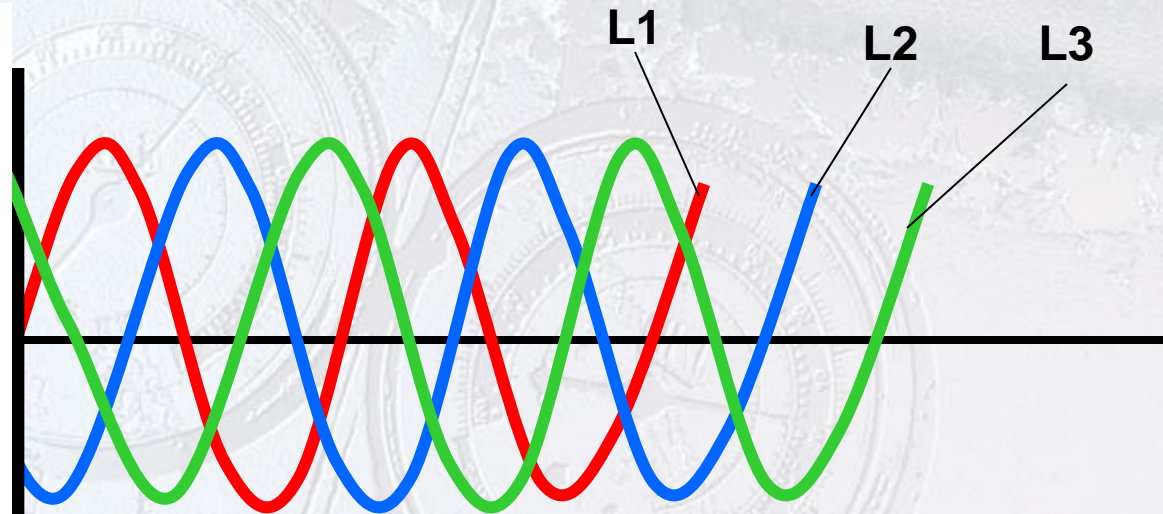

***THESE THREE POWER SUPPLIES ARE
GENERATED 120 DEGREES OUT OF PHASE
WITH EACH OTHER***

SINGLE-PHASE HERMETIC MOTORS

- Hermetically sealed from outside air
- Similar to single-phase motors
- Use relays to remove start winding from circuit
- They do not use centrifugal switches
- Often use run capacitors for increased efficiency
- Designed to operate in a refrigerant atmosphere
- Motor terminals identified as common, start & run


THE POTENTIAL RELAY

- Used on motors requiring high starting torque
- Coil with very high resistance
- Normally closed contacts
- Relay operates on the induced voltage across the start winding
- The contacts open when the induced voltage rises
- When the motor turns off, the induced voltage drops and the relay contacts close

Refrigeration & Air Conditioning Technology

SIXTH EDITION

THE POTENTIAL RELAY

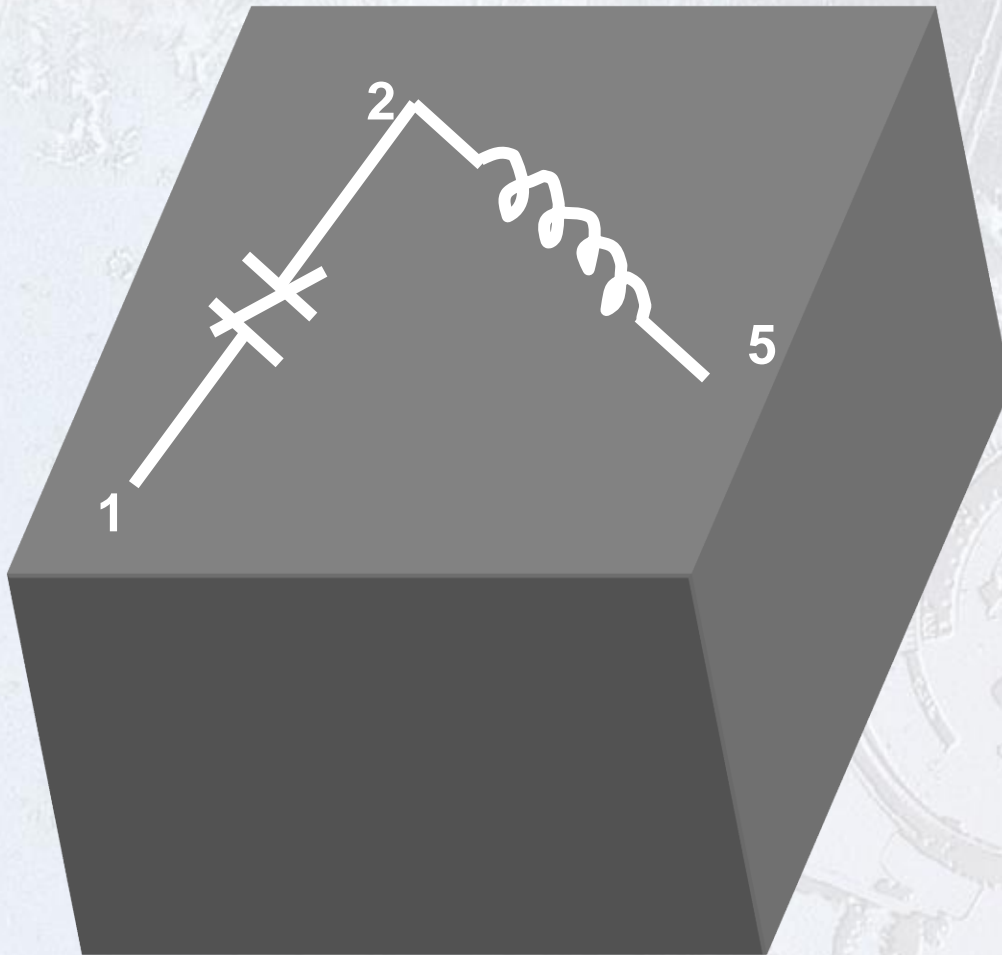


Normally close contacts
connected between terminals 1
and 2

Coil connected between
terminals 2 and 5

Refrigeration & Air Conditioning Technology

SIXTH EDITION

CAPACITOR-START, CAPACITOR-RUN MOTOR (CSCR)

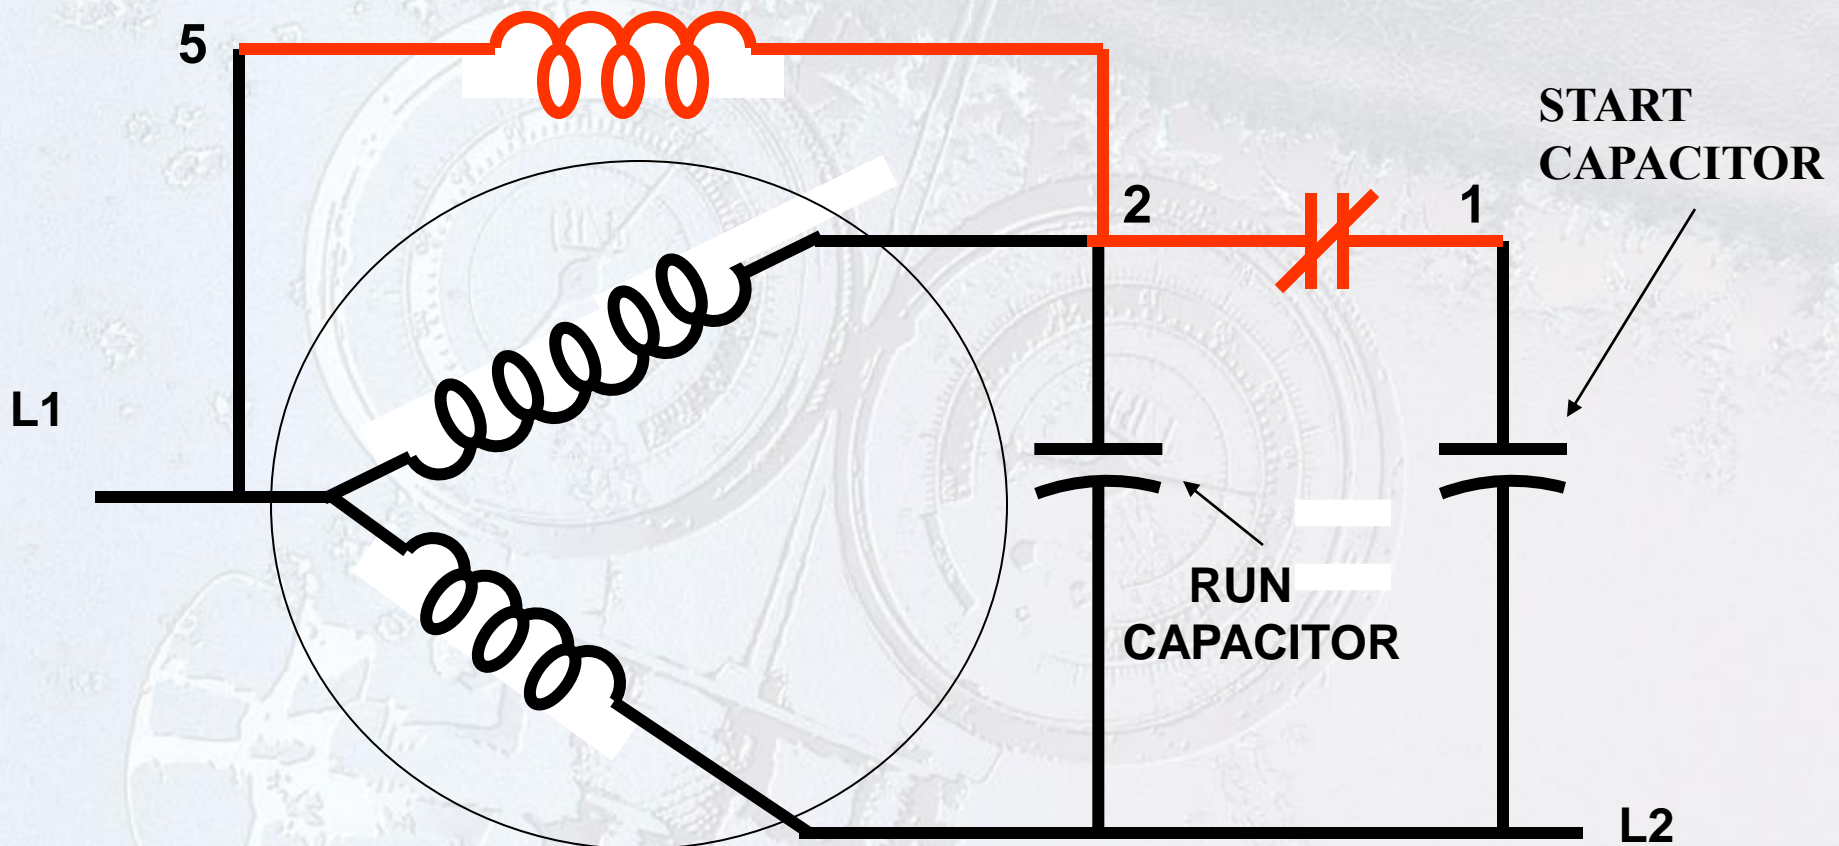

THE CURRENT RELAY

- Used on fractional horsepower motors
- Used with fixed-orifice metering devices
- Low resistance coil in series with the run winding
- Normally open contacts in series with start winding
- Upon startup only the run winding is energized
- The motor draws locked rotor amperage
- The increased amperage closes the relay contacts
- The start winding is energized and the motor starts
- The amperage drops and the relay contacts open

Refrigeration & Air Conditioning Technology

SIXTH EDITION

START WINDING

Small Wire

Large Number of Turns

High Resistance

L1


RUN WINDING

Larger Wire

Small Number of Turns

Low Resistance

THE CURRENT MAGNETIC RELAY (CMR)

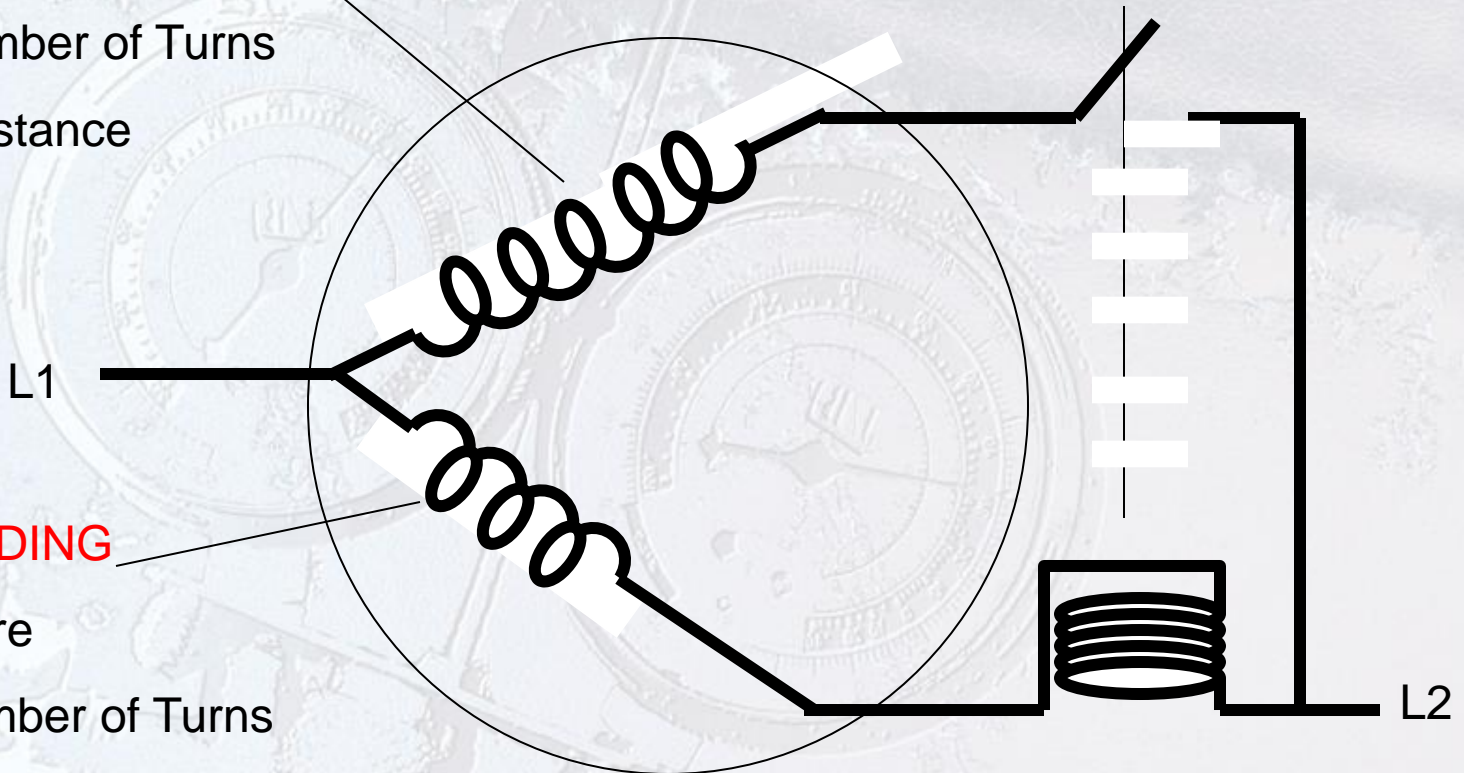

POSITIVE TEMPERATURE COEFFICIENT (PTC) START DEVICE

- Thermistors change resistance with changes in temperature
- During startup, the resistance of the PTC is about 4 to 10 ohms
- As the motor operates, current flow generates heat that causes the resistance to increase
- Resistance can increase to 10,000 to 12,000 ohms

TWO-SPEED COMPRESSOR MOTORS

- Used to control the capacity of compressors
- Speed changes are obtained by wiring changes
- The thermostat controls the wiring changes
- Considered to be two compressors in one housing
- One motor turns at 1800 rpm, the other at 3600
- Two-speed compressors have more than three motor terminals

SPECIAL APPLICATION MOTORS

- Some single-speed motors have more than three motor terminals
- Some have auxiliary compressor windings to increase the motor efficiency
- Some motors have winding thermostats wired through the compressor shell
- Three-phase motors have one thermostat for each winding
- The winding thermostats are wired in series

THREE-PHASE COMPRESSOR MOTORS

- Used in large commercial/industrial applications
- Normally have three motor terminals
- No capacitors are required
- Resistance across each winding is the same
- Three-phase motors have high starting torque
- Some larger three-phase compressor motors operate as dual voltage device

VARIABLE SPEED MOTORS

- Motor speed decreases during low load conditions
- Voltage and frequency determine motor speed
- New motors are controlled by electronic circuits
- Variable speed direct current (dc) motors
- Electronically commutated (ECM) dc motors
- Motors can ramp up or down to reduce motor wear
- AC current can be converted to DC using rectifiers

DC CONVERTERS (RECTIFIERS)

- Phase-controlled rectifier
 - Converts ac power to dc power
 - Uses silicon controlled rectifiers and transistors
 - Capacitors smooth out the dc voltage
- Diode bridge rectifier
 - Does not regulate the dc voltage
 - Diodes are not controllable
 - Voltage and frequency are adjusted at the inverter

INVERTERS

- Vary the frequency to obtain the desired speed
- Six-step inverter
 - Receives voltage from the converter
 - Can control the voltage or the current
- Pulse width modulator (PWM)
 - Receives fixed dc voltage from the converter
 - Voltage is pulsed to the motor
 - Short pulses at low speed, long pulses at high speed

ELECTRONICALLY COMMUTATED MOTORS (ECM)

- Used on open drive fans less than 1 hp
- Armature is commutated with permanent magnets
- Motors are factory calibrated
- Two-piece motor: motor section and controls
- Motor can be checked with an ohmmeter
- Controls can be checked with a test module
- Defective controls can be replaced

COOLING ELECTRIC MOTORS

- All motors must be cooled
- Hermetic compressor motor are cooled by air and refrigerant
- Open motors are cooled by air
- Open motors must be located where there is a good supply of air
- Some very large motors are cooled by water

UNIT SUMMARY - 1

- Motors facilitate the circulation of air, water, refrigerant and other fluids
- Some applications require high starting torque
- Motor components include the housing, rotor, stator, end bells, bearings and motor mount
- Electricity and magnetism create motor rotation
- Motor speed is determined by the number of poles
- The start winding has higher resistance than the run winding
- Important motor amperage are LRA, FLA and RLA

UNIT SUMMARY - 2

- Residences are supplied with single-phase power
- Some motors are designed to operate at more than one voltage
- Split phase motors have a medium amount of starting torque and good running efficiency
- The centrifugal switch opens and closes its contacts depending on the speed of the motor
- The current relay opens and closes its contacts depending on the current flow through the run winding

UNIT SUMMARY - 3

- The potential relay opens and closes its contacts depending on the induced voltage across the start winding
- Capacitor start motors use start capacitors to increase the starting torque of the motor
- The start winding and start capacitor are removed from the circuit after the motor starts
- Capacitor start, capacitor run motors use both start and run capacitors
- Run capacitors help increase the motor's running efficiency

UNIT SUMMARY - 4

- The PSC motor uses only a run capacitor
- The shaded pole motor has very low starting torque
- Three-phase motors are used for commercial and industrial applications
- The PTC and NTC are electronic device that change their resistance as the sensed temperature changes
- Variable speed motors ramp up and down, often using dc converters, inverters and rectifiers
- ECM motors are commutate with permanent magnets